
INSTALLATION DETAIL

USE ONLY DURASLOPE CLASS 'D' GRATES WITH THIS APPLICATION

NOTE:

CHANNELS TO BE INSTALLED WITH BLANK GRATE TO BE PROTECTED FROM CONCRETE POUR (COVER HOLES WITH TAPE)

SET TRENCH DRAIN CHANNEL SURROUNDED BY 8" OF CONCRETE WITH A MINIMUM OF 4,000 P.S.I. AVOID FULL LOAD TRAFFIC FOR 28 DAYS OR UNTIL CONCRETE HAS COMPLETELY HARDENED.

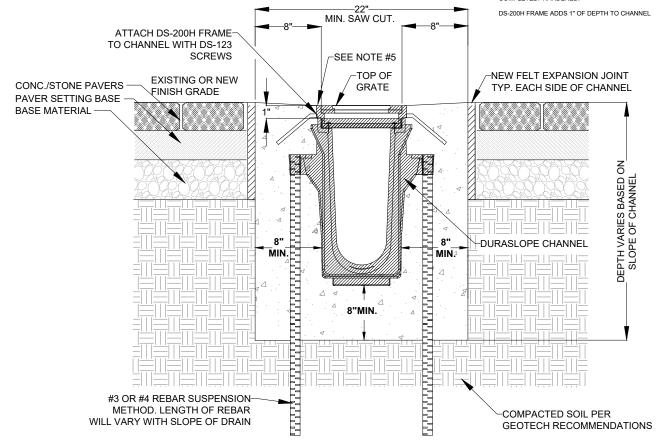

NOTES:

- 1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
- EXPANSION AND CONTRACTION CONTROL JOINTS ARE RECOMMENDED TO PROTECT THE CHANNEL AND SURROUNDING CONCRETE. CONSULT WITH AN ENGINEER NECESSARY.
- 3. MINIMUM CONCRETE COMPRESSIVE STRENGTH OF 4000 PSI AND VIBRATION TO ELIMINATE AIR POCKETS IS RECOMMENDED.
- 4. THIS DRAWING IS INTENDED FOR USE BY ARCHITECTS, ENGINEERS AND CONTRACTORS FOR PLANNING PURPOSES.
- 5. RECESS CHANNEL AND GRATE 1/8" FOR PEDESTRIAN TRAFFIC, 1/4" FOR VEHICULAR TRAFFIC.
- 6. DRAWING IS NOT TO SCALE.



DURA SLOPE TRENCH DRAIN TYPICAL INSTALLATION WITH DS-200H FRAMES

CLASS 'D' 8" LOAD APPLICATION FOR PAVERS / REBAR SUSPENSION METHOD

FOR PRODUCT ASSISTANCE, CONTACT NDS TECHNICAL SERVICE AT techservice@ndspro.com, DESIGN ASSISTANCE- designworx@ndspro.com 851 N. HARVARD AVE. LINDSAY, CA 93247 WWW.NDSPRO.COM 1-800-726-1994 OPT 3